
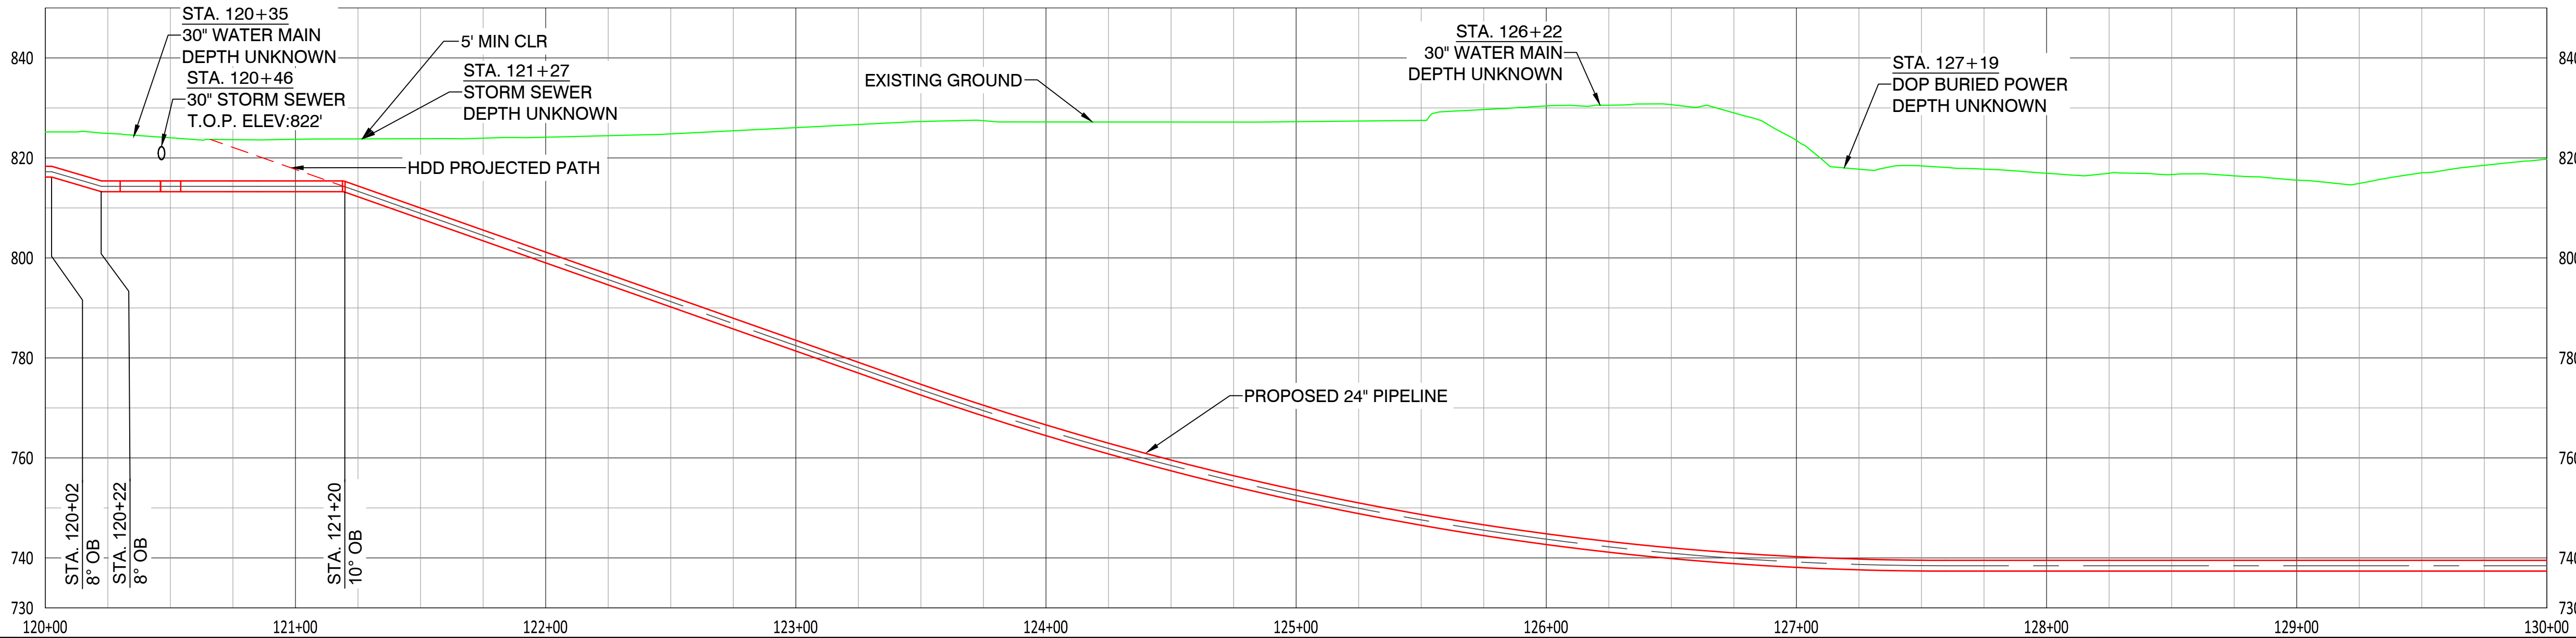


OWNERSHIP	CITY OF COLUMBUS		OHIO DOT
JURISDICTION / PARCEL ID	CITY OF COLUMBUS / FRANKLIN COUNTY		CITY OF COLUMBUS / FRANKLIN COUNTY
TEST PRESSURE / DESIGN INFO	1080 PSIG MIN / 1280 PSIG MAX / CLASS IV / 720 PSIG		
CONSTRUCTION METHOD	OPEN CUT	HDD	
PIPE			
FITTINGS			

HORIZONTAL STATIONING

PROPOSED PLAN
(SCALE: 1" = 40')

PROPOSED PROFILE
(SCALE HORIZ: 1" = 40' / SCALE VERT: 1" = 20')

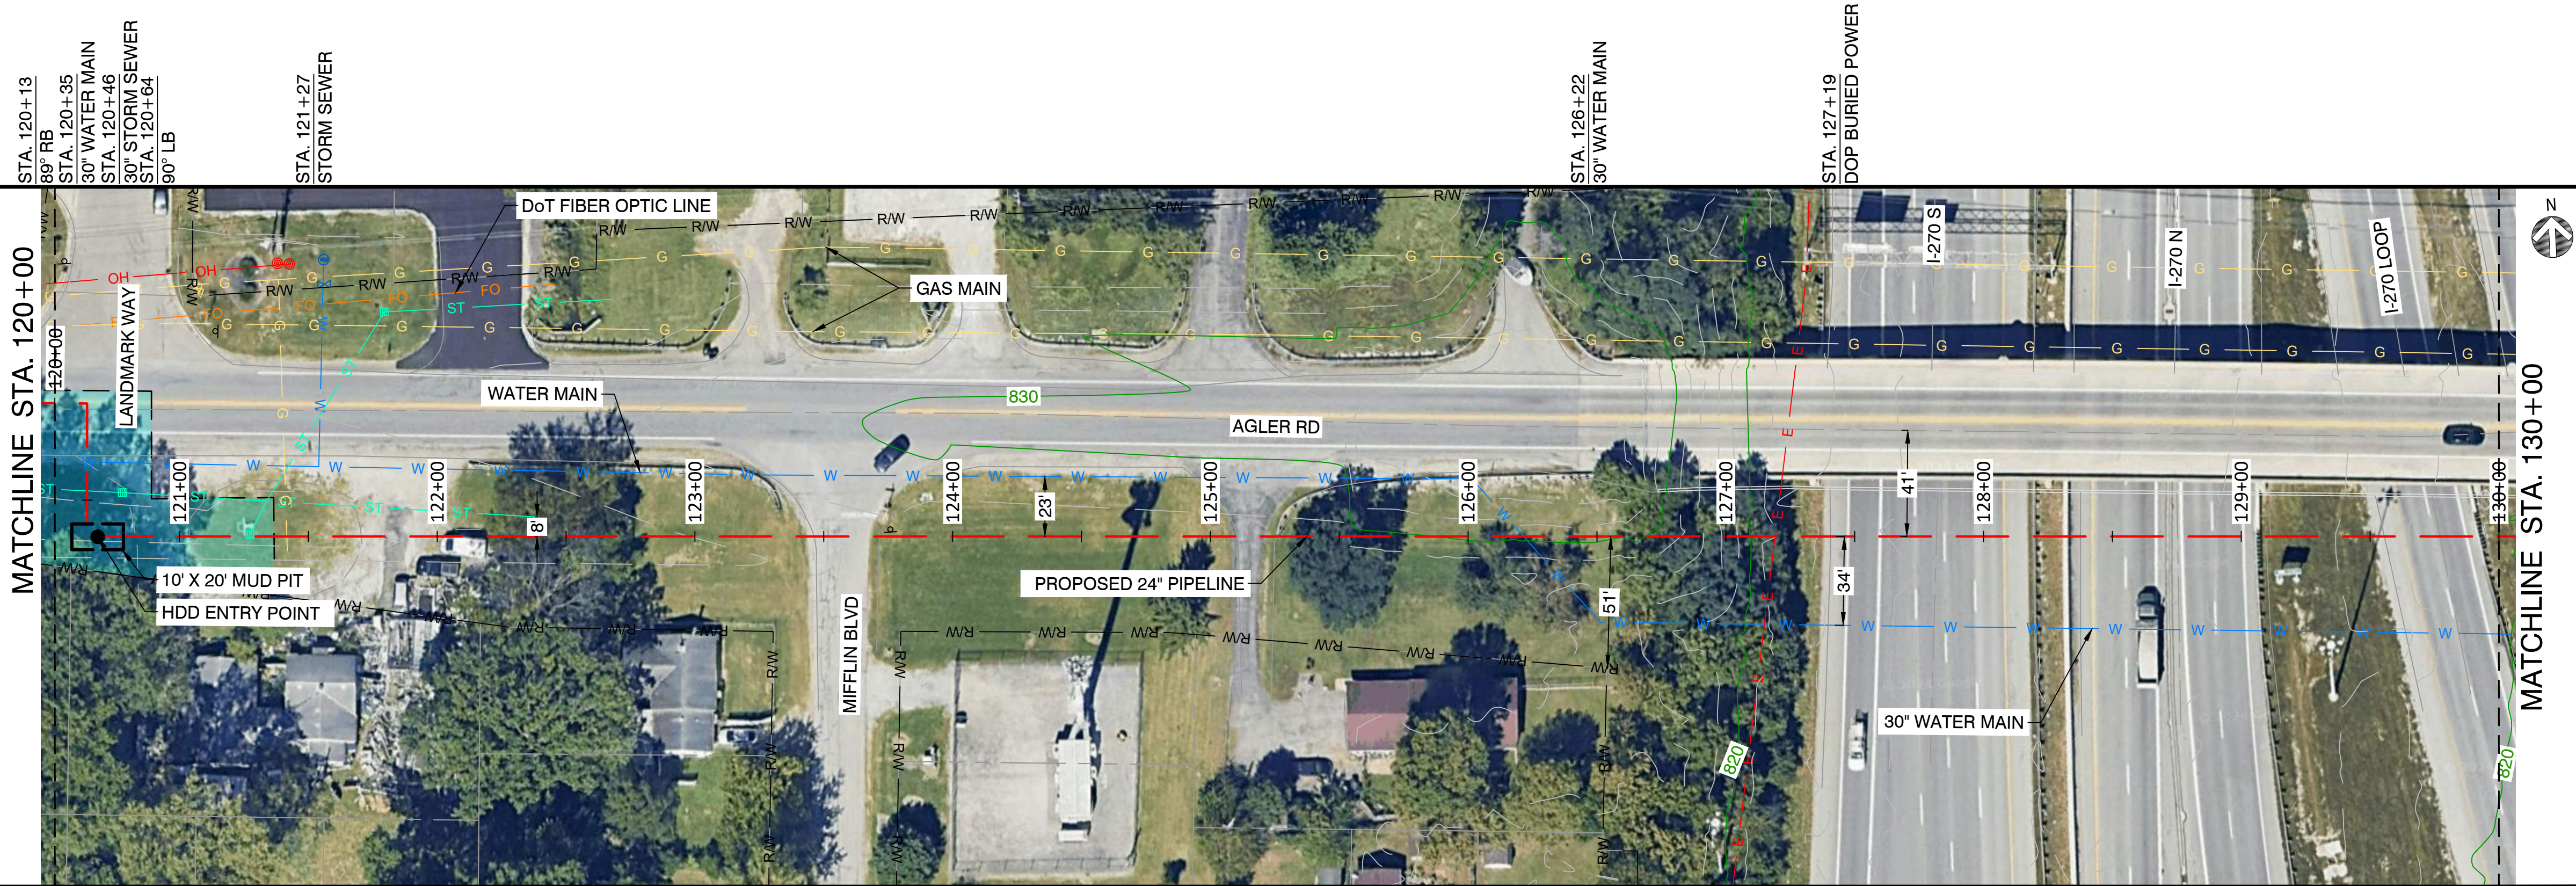

NOTES:

- CONTRACTOR SHALL VERIFY ALL UTILITY CROSSINGS
- SERVICE LINE CROSSINGS SHOWN IN SURVEY ARE NOT STATIONED OR SHOWN IN PROFILE FOR CLARITY
- THE PIPELINE HAS GENERALLY BEEN DESIGNED WITH A COVER OF 6'-0" TO ACCOUNT FOR THE DEPTH OF UNKNOWN SERVICE LINES. MINIMUM ALLOWABLE
- DEPTH OF COVER IS 4'-0"
- CORROSION PROTECTION IS DESIGNED BY NISOURCE AND IS NOT COVERED WITHIN THE ENGINEER'S STAMP
- VERTICAL BENDS CALLED OUT IN PROFILE ARE FOR REFERENCE. CONTRACTOR TO MAKE USE OF ROPING AND FIELD BENDS WHERE POSSIBLE. REFER TO GS 3010.030 FOR FURTHER DETAILS
- AERIAL IMAGERY IS FOR REFERENCE ONLY
- FITTING EXTENTS SHOWN IN THE PROFILE ARE FOR REFERENCE ONLY. REFER TO STATIONING BAND FOR LOCATIONS OF ANTICIPATED FITTINGS. A 3X DIAMETER OF STRAIGHT PIPE IS REQUIRED BETWEEN ALL FITTINGS. REFER TO GS 2110.020 FOR FURTHER DETAILS

NiSource

Ohio Utilities Protection Service

Call 811
before you dig

CAMPOS
EPC

401 N Front St, Suite 380, Columbus, OH 43215
(380) 799-8503

PROPOSED

REVISIONS

REV. #	DATE	DESCRIPTION
A	12/23/24	ISSUED FOR PERMIT
INTERNAL ENG.	AD	12/23/24 614-981-0661
DESIGNED BY	JMJ	12/23/24 855-266-7671
CHECKED BY	RBW	12/23/24 855-266-7671
AS-BUILT BY	TBD	TBD TBD

SITE NAME:

INST# 23-0083895-00
ABAN# 23-0083897-00
PROJECT ID# 21-78793
AGLER ROAD NCHP PIPELINE PROJECT
COLUMBUS/GAHANNA, FRANKLIN COUNTY, OH

DRAWING TITLE:

STA. 120+00 TO STA. 130+00

DRAWING NO:

L-2014

