



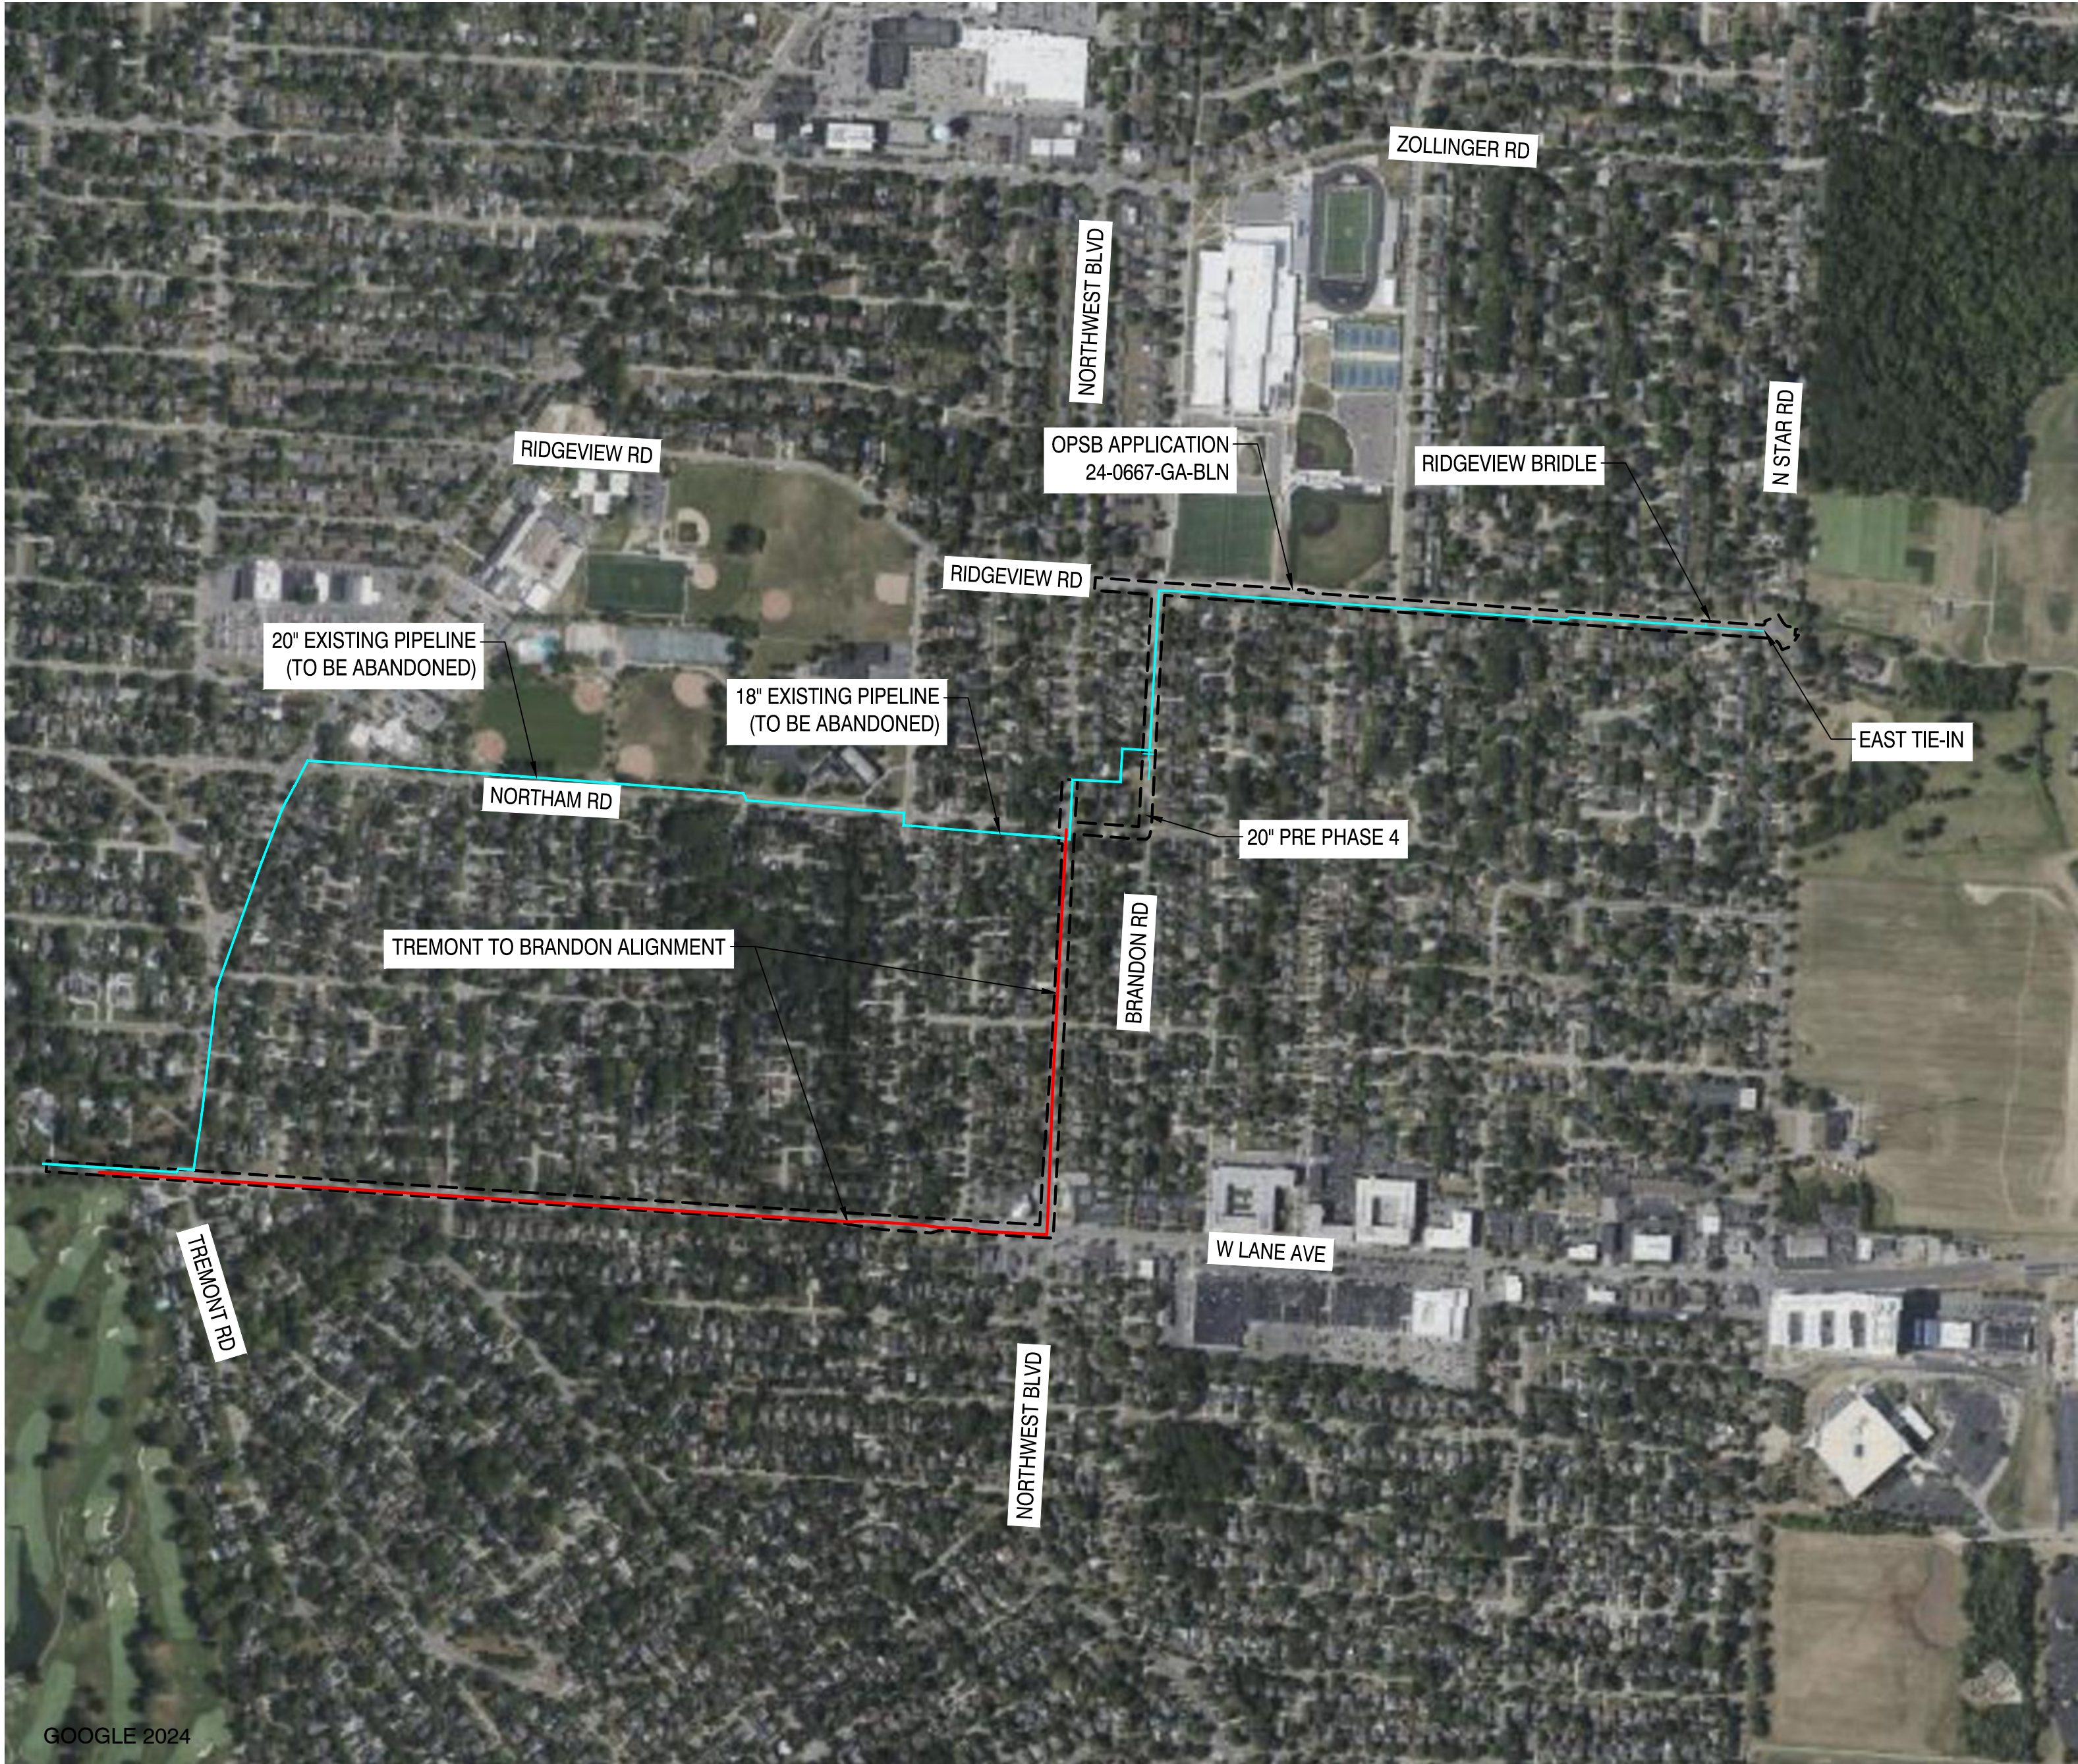

GOOGLE 2024

OVERVIEW SHEET INDEX
SCALE: 1"=500'

NOTE:
1. AERIAL IMAGERY IS FOR REFERENCE ONLY



NiSource

Ohio Utilities Protection Service



401 N Front St, Suite 380, Columbus, OH 43215
(380) 799-8503

DRAFT

REVISIONS

A	06/20/25	ISSUED FOR PERMIT
REV. #	DATE	DESCRIPTION

INTERNAL ENG.	EK	05/31/23	614-981-0661
DESIGNED BY	JEM	05/31/23	855-266-7671
CHECKED BY	JMJ	05/31/23	855-226-7671
AS-BUILT BY	TBD	TBD	TBD
	NAME	DATE	PHONE #

SITE NAME:

INST# 24-0137354-00
ABAN# 24-0137355-00
INST# 24-0136890-00
ABAN# 24-0136891-00
PROJECT ID# 21-78791

NCHP PIPELINE REPLACEMENT, WEST CENTRAL
UPPER ARLINGTON, FRANKLIN COUNTY, OH

DRAWING TITLE:



OVERVIEW SHEET

DRAWING NO:

EX-200

OWNERSHIP	CITY OF UPPER ARLINGTON	
JURISDICTION / PARCEL ID	CITY OF UPPER ARLINGTON / FRANKLIN COUNTY	
TEST PRESSURE / DESIGN INFO	1080 PSIG MIN / 1280 PSIG MAX / CLASS IV / 720 PSIG	
CONSTRUCTION METHOD	OPEN CUT	
		STA. 10+00

HORIZONTAL STATIONING	
	STA. 1+17 DOT TELECOMM LINE
	STA. 1+97 DOP BURIED POWER
	STA. 3+00 4" GAS MAIN
	STA. 3+00 48" STORM SEWER
	STA. 3+16 BURIED POWER
	STA. 3+15 TR OVERHEAD POWER
	STA. 3+18 2" DOT FIBER OPTIC
	STA. 3+21 BURIED POWER
	STA. 3+24 DOP OVERHEAD POWER
	STA. 3+83 8" SANITARY SEWER
	STA. 3+85 48" STORM SEWER
	STA. 3+87 8" WATER MAIN
	STA. 3+90 4" GAS MAIN
	STA. 6+25 TR OVERHEAD POWER
	STA. 7+23 48" STORM SEWER

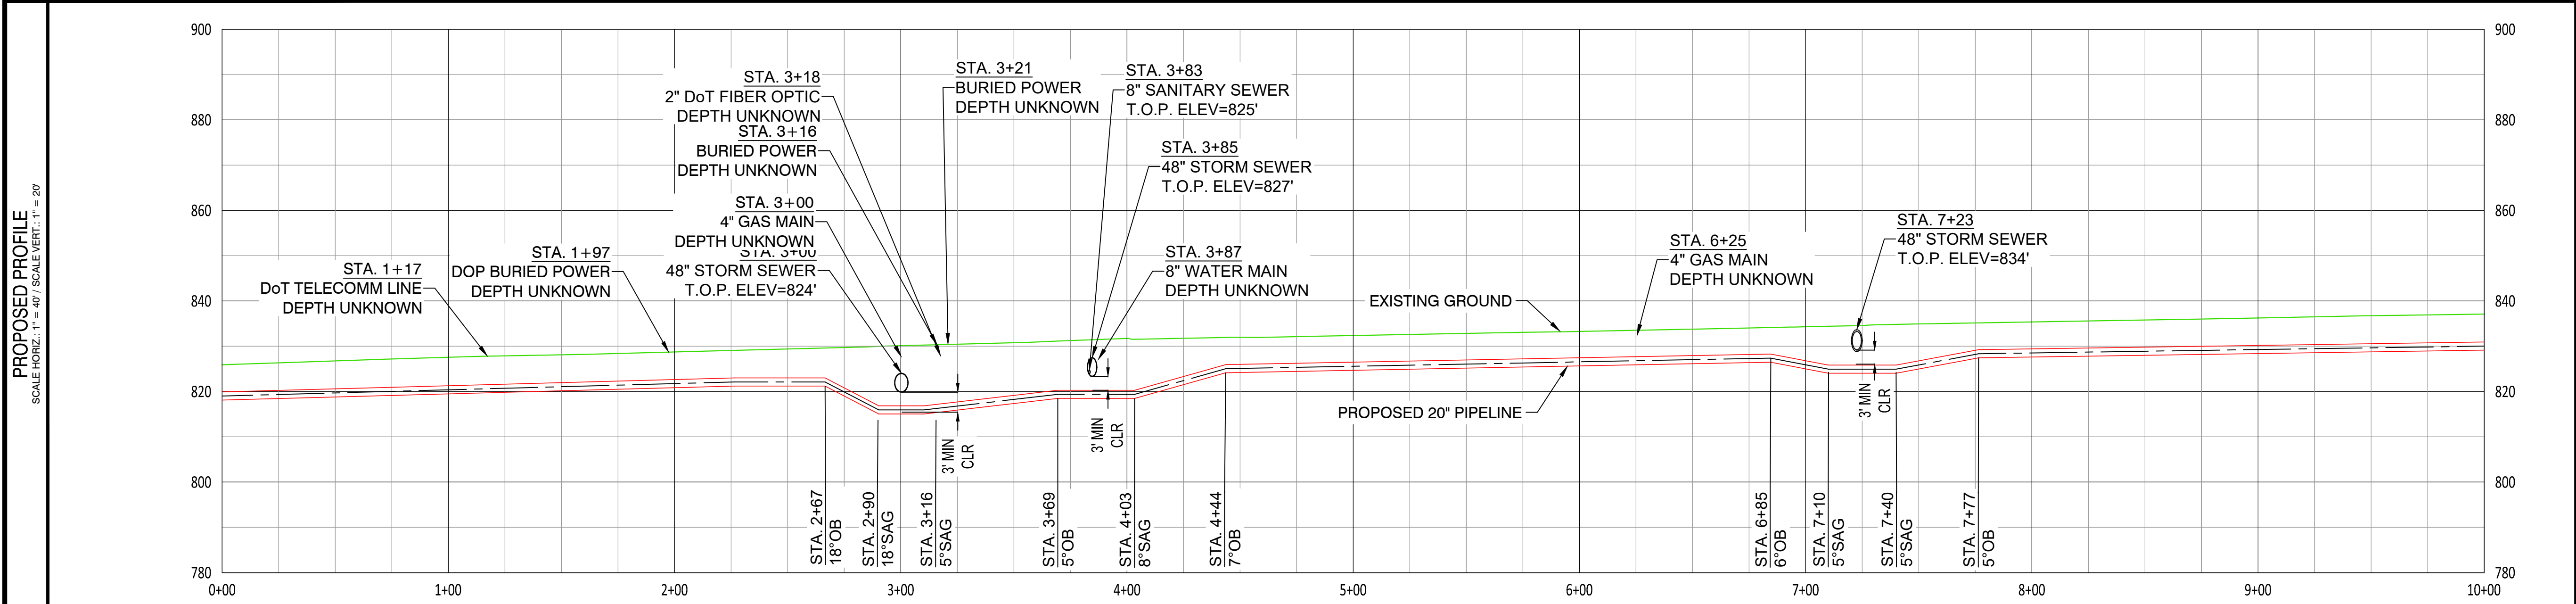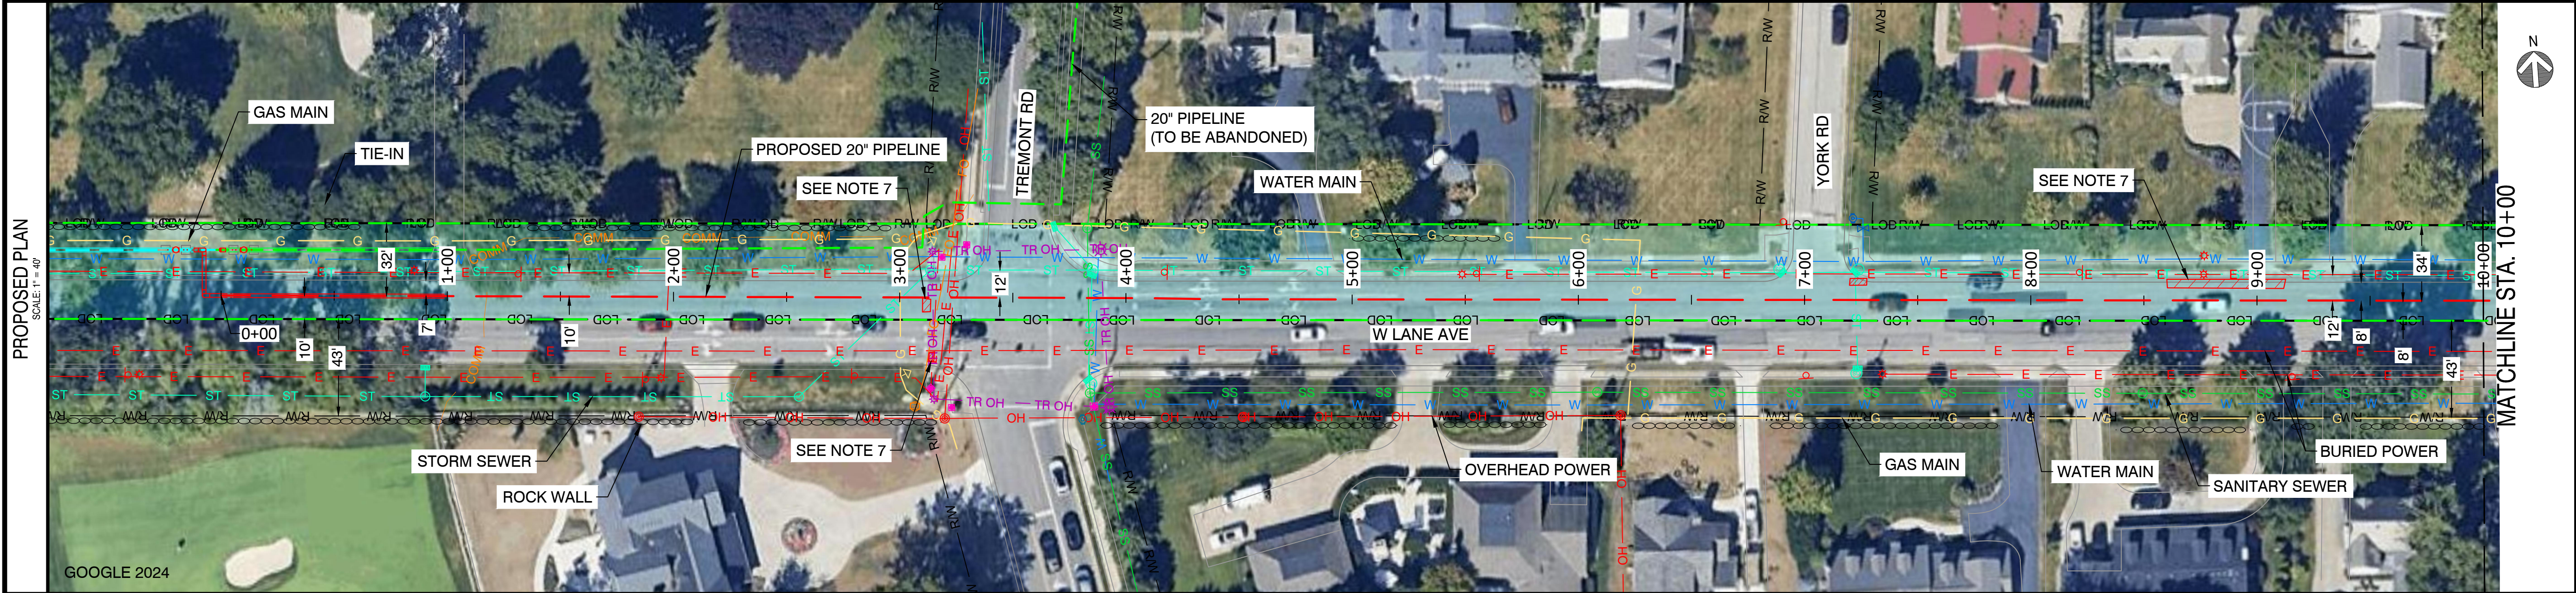

NOTES:	
1. CONTRACTOR SHALL VERIFY ALL UTILITY CROSSINGS	5. CORROSION PROTECTION IS DESIGNED BY NISOURCE AND IS NOT COVERED WITHIN THE ENGINEER'S STAMP
2. SERVICE LINE CROSSINGS SHOWN IN SURVEY ARE NOT STATIONED OR SHOWN IN PROFILE FOR CLARITY	6. AERIAL IMAGERY IS FOR REFERENCE ONLY
3. THE PIPELINE HAS GENERALLY BEEN DESIGNED WITH A COVER OF 6'-0" TO ACCOUNT FOR THE DEPTH OF UNKNOWN SERVICE LINES. MINIMUM ALLOWABLE DEPTH OF COVER IS 4'-0"	7. GPR FOUND EVIDENCE OF A TRENCH. SURVEY IS UNABLE TO CONFIRM WHETHER A UTILITY EXISTS WITHIN THIS TRENCH.
4. VERTICAL BENDS CALLED OUT IN PROFILE ARE FOR REFERENCE. CONTRACTOR TO MAKE USE OF ROPING AND FIELD BENDS WHERE POSSIBLE	



401 N Front St, Suite 380, Columbus, OH 43215
(303) 623-3345

DRAFT

REVISIONS



A	07/10/25	ISSUED FOR PERMIT	
REV. #	DATE	DESCRIPTION	
DESIGNED BY	EK	05/31/23	614-981-0661
DRAWN BY	JEM	05/31/23	855-266-7671
CHECKED BY	JMJ	05/31/23	855-226-7671
AS-BUILT BY	TBD	TBD	TBD
	NAME	DATE	PHONE #

SITE NAME:
INST# 24-0137354-00
ABAN# 24-0137355-00
INST# 24-0136890-00
ABAN# 24-0136891-00
PROJECT ID# 21-78791
NCHP PIPELINE REPLACEMENT, WEST CENTRAL
UPPER ARLINGTON, FRANKLIN COUNTY, OH

DRAWING TITLE:
20' TREMONT TO BRANDON ALIGNMENT
STA. 0+00 TO STA. 10+00

DRAWING NO:
L-2001

PROPOSED PLAN

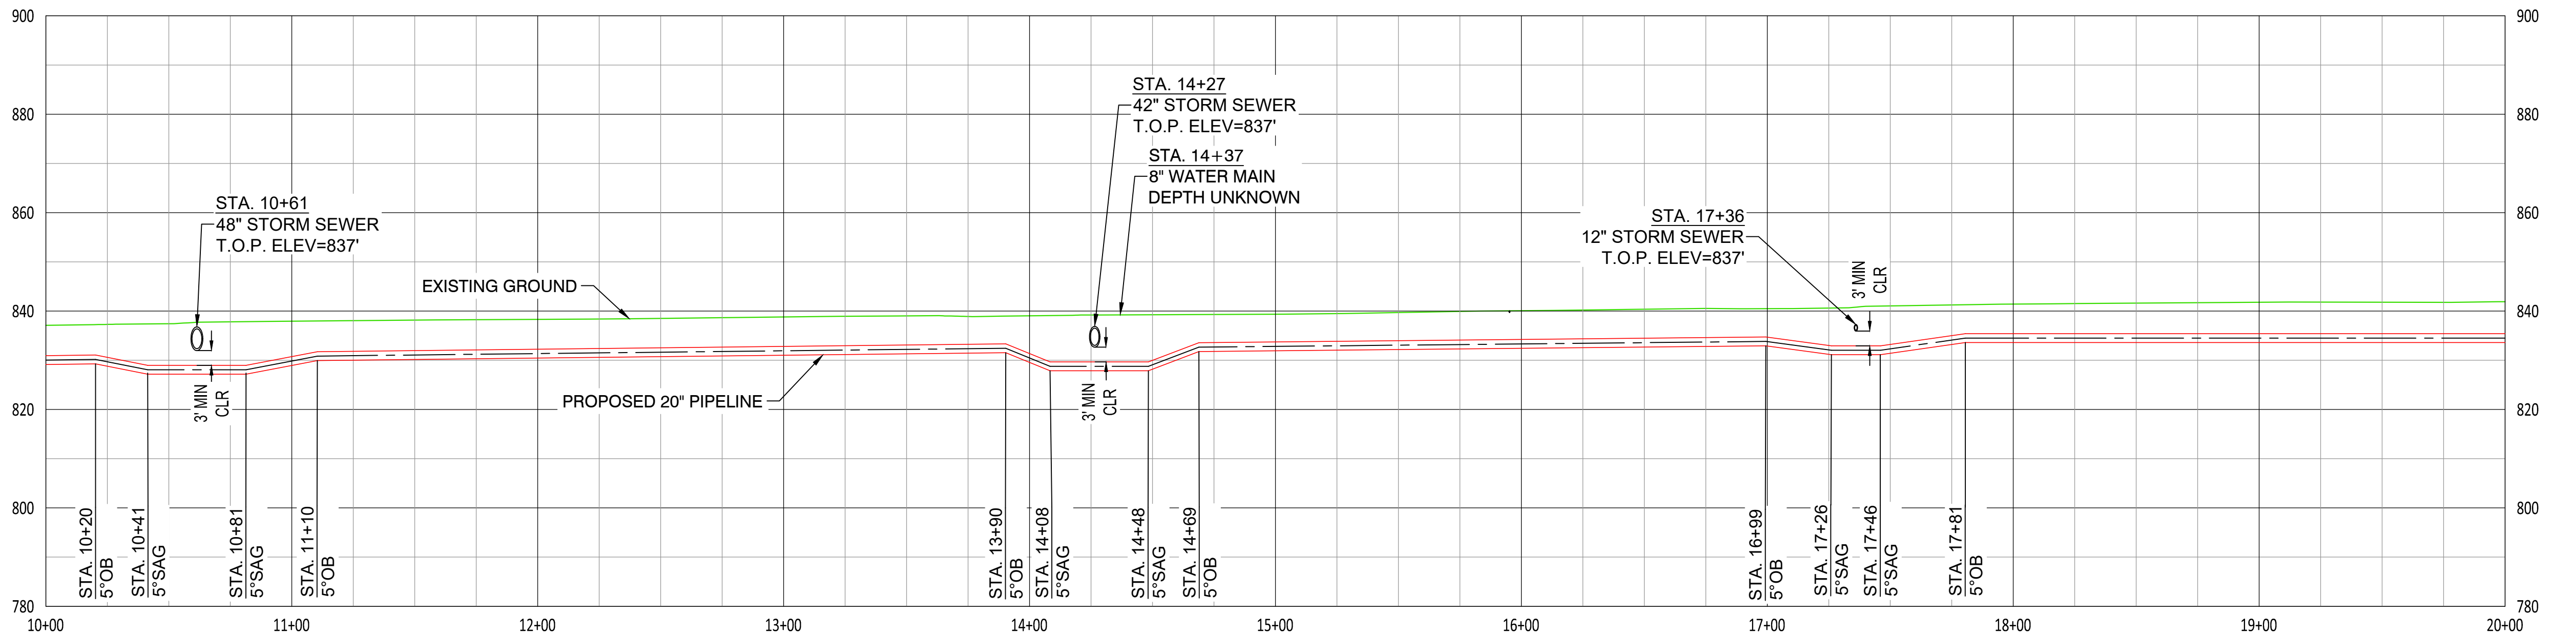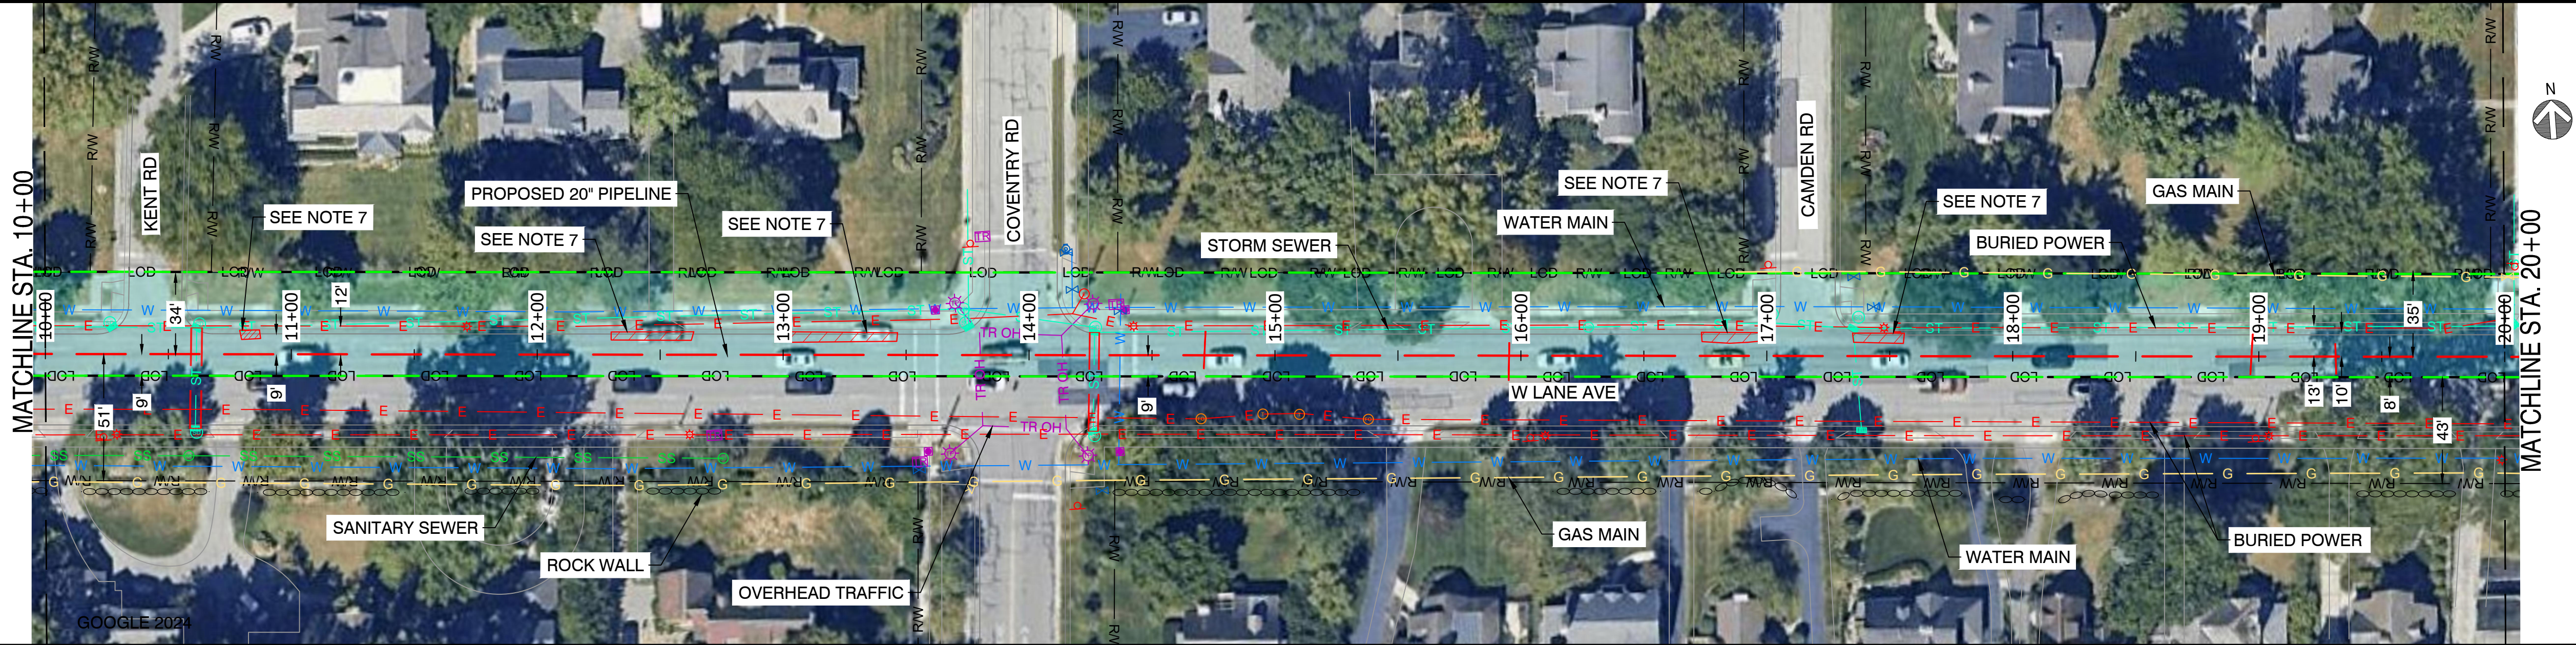

- 

Ohio Utilities Protection Service

Call 811
before you dig



401 N Front St, Suite 380, Columbus, OH 43215
(303) 623-3345

DRAFT

REVISIONS

A	07/10/25	ISSUED FOR PERMIT		
REV. #	DATE	DESCRIPTION		
DESIGNED BY	EK	05/31/23	614-981-0661	
DRAWN BY	JEM	05/31/23	855-266-7671	
CHECKED BY	JMJ	05/31/23	855-226-7671	
AS-BUILT BY	TBD	TBD	TBD	
	NAME	DATE	PHONE #	

SITE NAME:

INST# 24-0137354-00
ABAN# 24-0137355-00
INST# 24-0136890-00
ABAN# 24-0136891-00
PROJECT ID# 21-78791

NCHP PIPELINE REPLACEMENT, WEST CENTRAL
UPPER ARLINGTON, FRANKLIN COUNTY, OH



DRAWING TITLE:
20' TREMONT TO BRANDON ALIGNMENT
STA. 10+00 TO STA. 20+00

DRAWING NO:

L-2002

OWNERSHIP	CITY OF UPPER ARLINGTON	
JURISDICTION / PARCEL ID	CITY OF UPPER ARLINGTON / FRANKLIN COUNTY	
TEST PRESSURE / DESIGN INFO	1080 PSIG MIN / 1280 PSIG MAX / CLASS IV / 720 PSIG	
CONSTRUCTION METHOD	OPEN CUT	
	STA. 20+00	STA. 30+00

HORIZONTAL STATIONING	
	STA. 20+41 36" STORM SEWER
	STA. 23+42 36" STORM SEWER
	STA. 23+47 DOP BURIED POWER
	STA. 26+78 8" GAS MAIN
	STA. 27+18 30" STORM SEWER

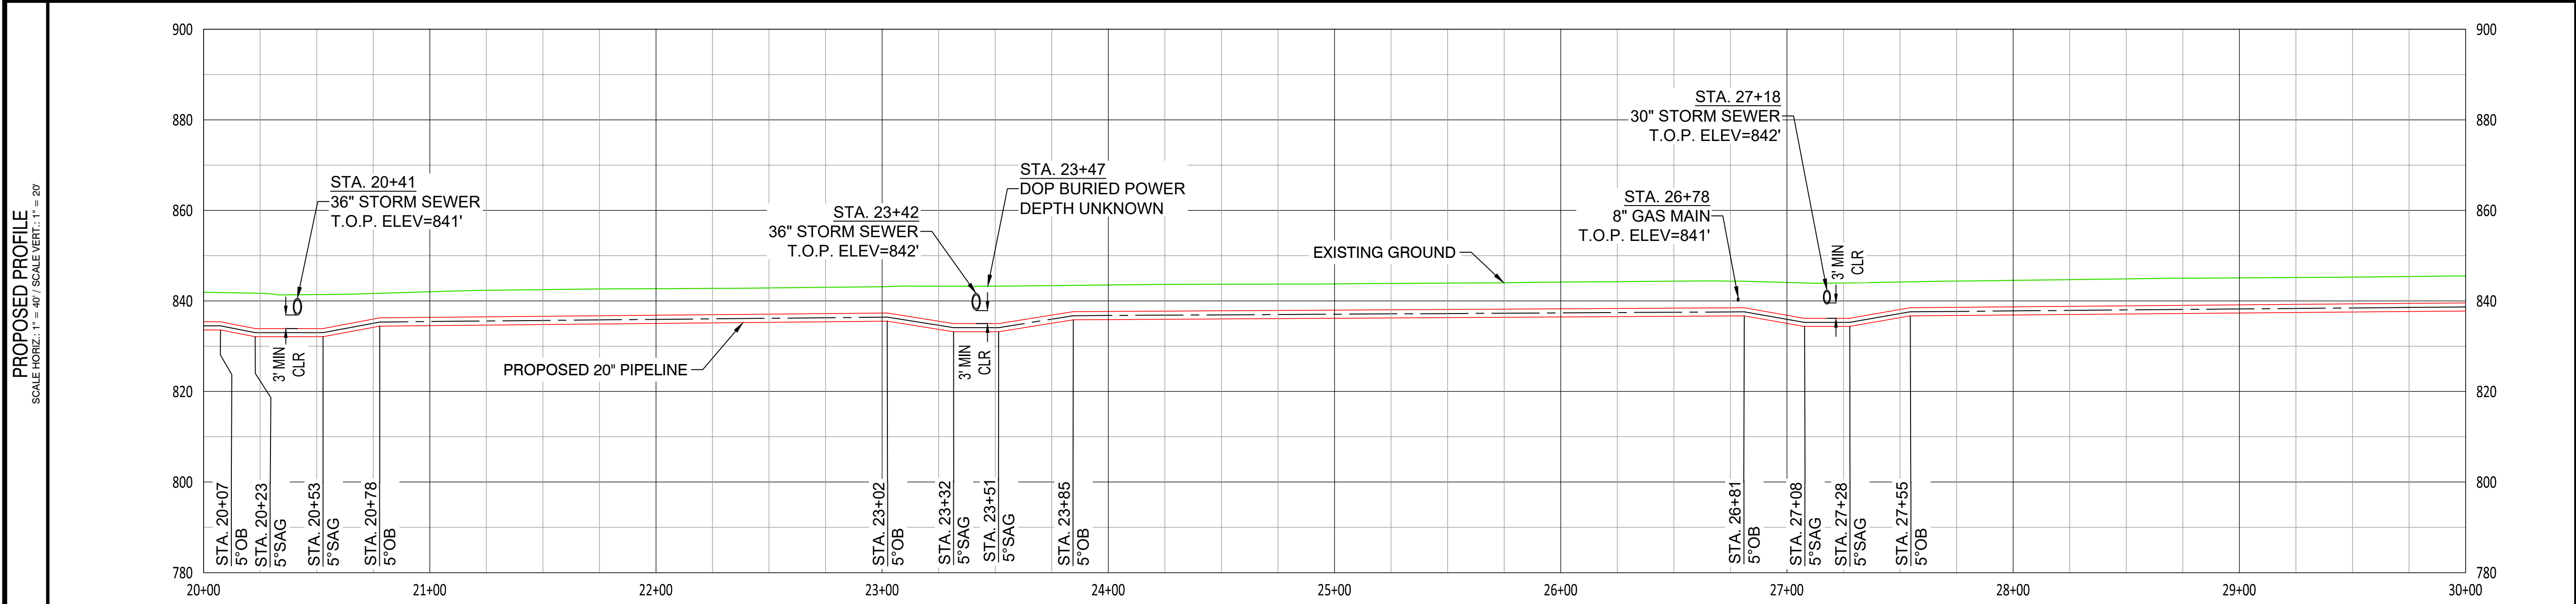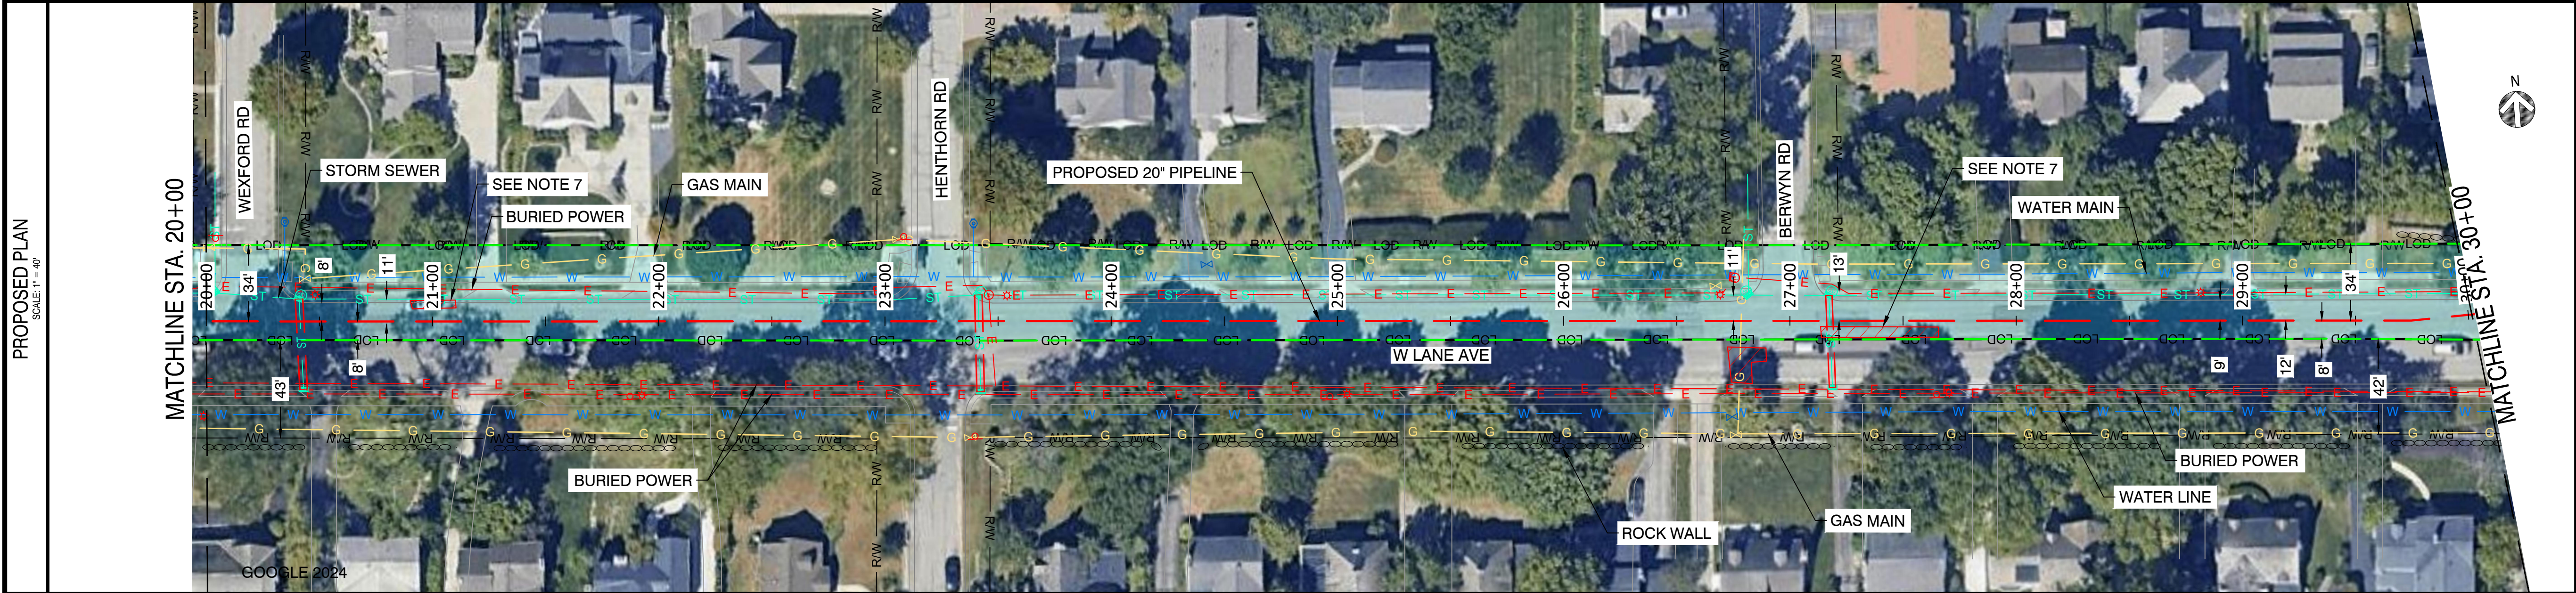

- NOTES:
- CONTRACTOR SHALL VERIFY ALL UTILITY CROSSINGS
 - SERVICE LINE CROSSINGS SHOWN IN SURVEY ARE NOT STATIONED OR SHOWN IN PROFILE FOR CLARITY
 - THE PIPELINE HAS GENERALLY BEEN DESIGNED WITH A COVER OF 6'-0" TO ACCOUNT FOR THE DEPTH OF UNKNOWN SERVICE LINES. MINIMUM ALLOWABLE DEPTH OF COVER IS 4'-0"
 - VERTICAL BENDS CALLED OUT IN PROFILE ARE FOR REFERENCE. CONTRACTOR TO MAKE USE OF ROPING AND FIELD BENDS WHERE POSSIBLE

- CORROSION PROTECTION IS DESIGNED BY NISOURCE AND IS NOT COVERED WITHIN THE ENGINEER'S STAMP
- AERIAL IMAGERY IS FOR REFERENCE ONLY
- GPR FOUND EVIDENCE OF A TRENCH. SURVEY IS UNABLE TO CONFIRM WHETHER A UTILITY EXISTS WITHIN THIS TRENCH.

NiSource

Ohio Utilities Protection Service
Call 811
before you dig

CAMPOS
EPC

401 N Front St, Suite 380, Columbus, OH 43215
(303) 623-3345

DRAFT

REVISIONS

REV. #	DATE	ISSUED FOR PERMIT	DESCRIPTION
A	07/10/25	ISSUED FOR PERMIT	
DESIGNED BY	EK	05/31/23	614-981-0661
DRAWN BY	JEM	05/31/23	855-266-7671
CHECKED BY	JMJ	05/31/23	855-226-7671
AS-BUILT BY	TBD	TBD	TBD
	NAME	DATE	PHONE #



SITE NAME:
INST# 24-0137354-00
ABAN# 24-0137355-00
INST# 24-0136890-00
ABAN# 24-0136891-00
PROJECT ID# 21-78791
NCHP PIPELINE REPLACEMENT, WEST CENTRAL
UPPER ARLINGTON, FRANKLIN COUNTY, OH

DRAWING TITLE:
20' TREMONT TO BRANDON ALIGNMENT
STA. 20+00 TO STA. 30+00

DRAWING NO:
L-2003

OWNERSHIP	CITY OF UPPER ARLINGTON	
JURISDICTION / PARCEL ID	CITY OF UPPER ARLINGTON / FRANKLIN COUNTY	
TEST PRESSURE / DESIGN INFO	1080 PSIG MIN / 1280 PSIG MAX / CLASS IV / 720 PSIG	
CONSTRUCTION METHOD	OPEN CUT	
		STA. 30+00

HORIZONTAL STATIONING		
	STA. 30+27 3"OB COMBO 6" RB	
	STA. 31+01 DOP OVERHEAD POWER	
	STA. 31+20 8" WATER MAIN	
	STA. 31+33 15" STORM SEWER	
	STA. 32+53 4" RB	
	STA. 33+28 6" LB	
	STA. 33+91 18" STORM SEWER	
	STA. 34+34 8" RB	
	STA. 34+55 DOP BURIED POWER	
	STA. 34+94 8" LB	
	STA. 36+76 TR BURIED POWER	
	STA. 36+85 15" SANITARY SEWER	
	STA. 36+90 12" WATER MAIN	
	STA. 37+02 8" DoT FIBER OPTIC	
	STA. 37+09 21" STORM SEWER	
	STA. 37+54 90" LB	
	STA. 37+85 4" GAS MAIN	
	STA. 37+85 12" SANITARY SEWER	
	STA. 38+00 TR BURIED POWER	
	STA. 38+06 12" STORM SEWER	

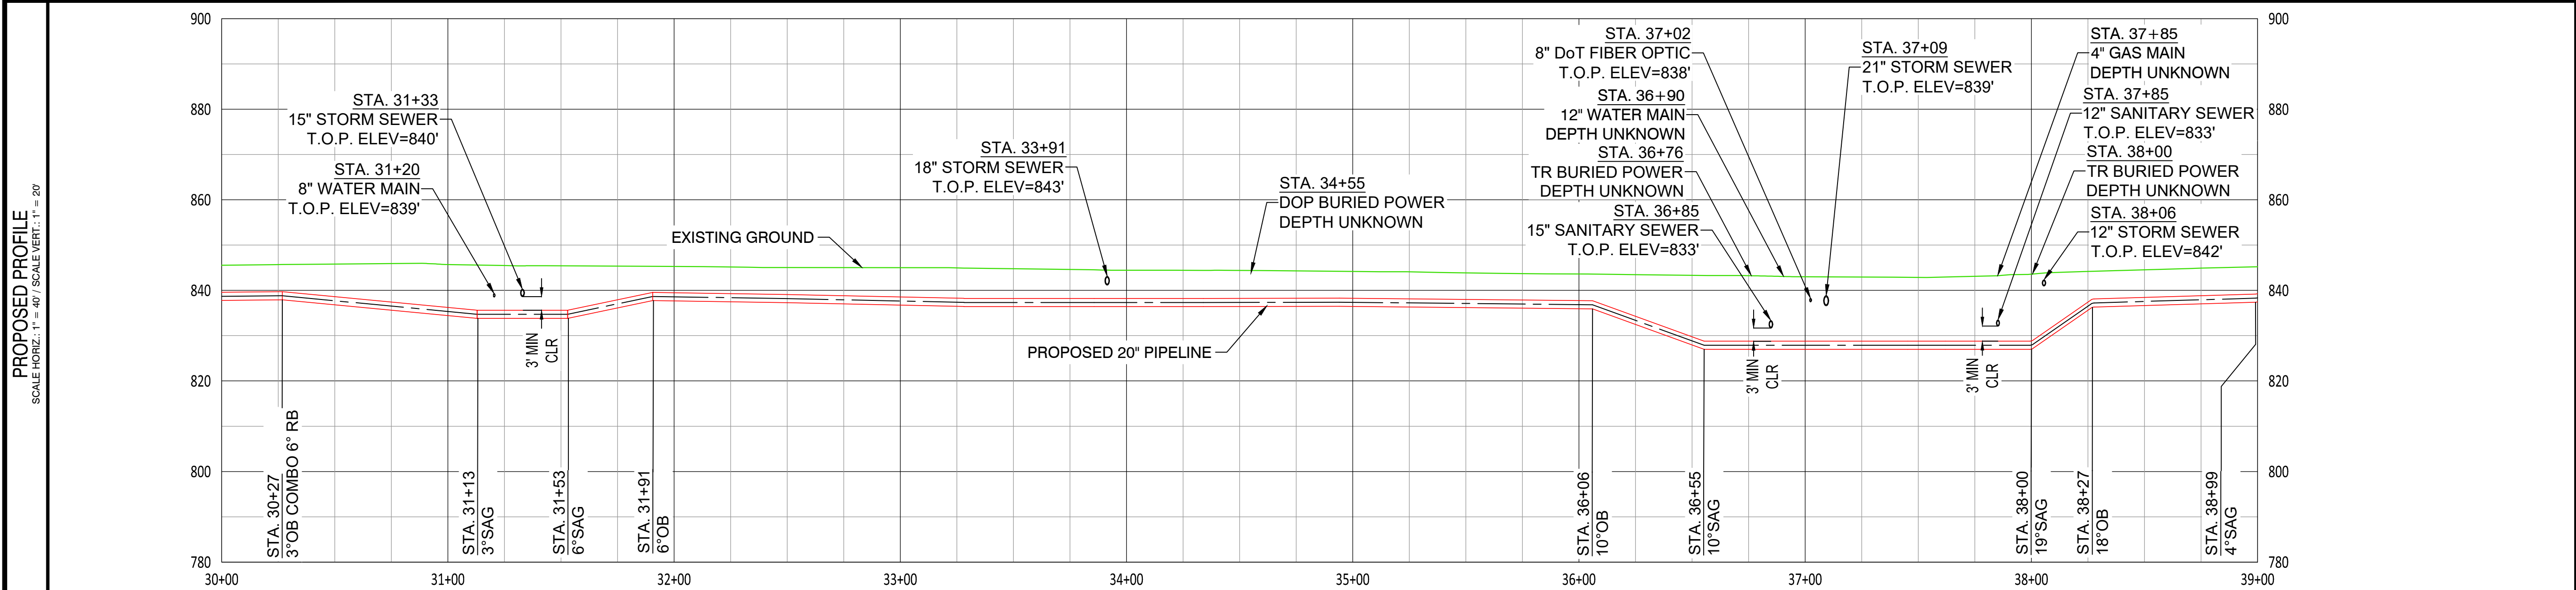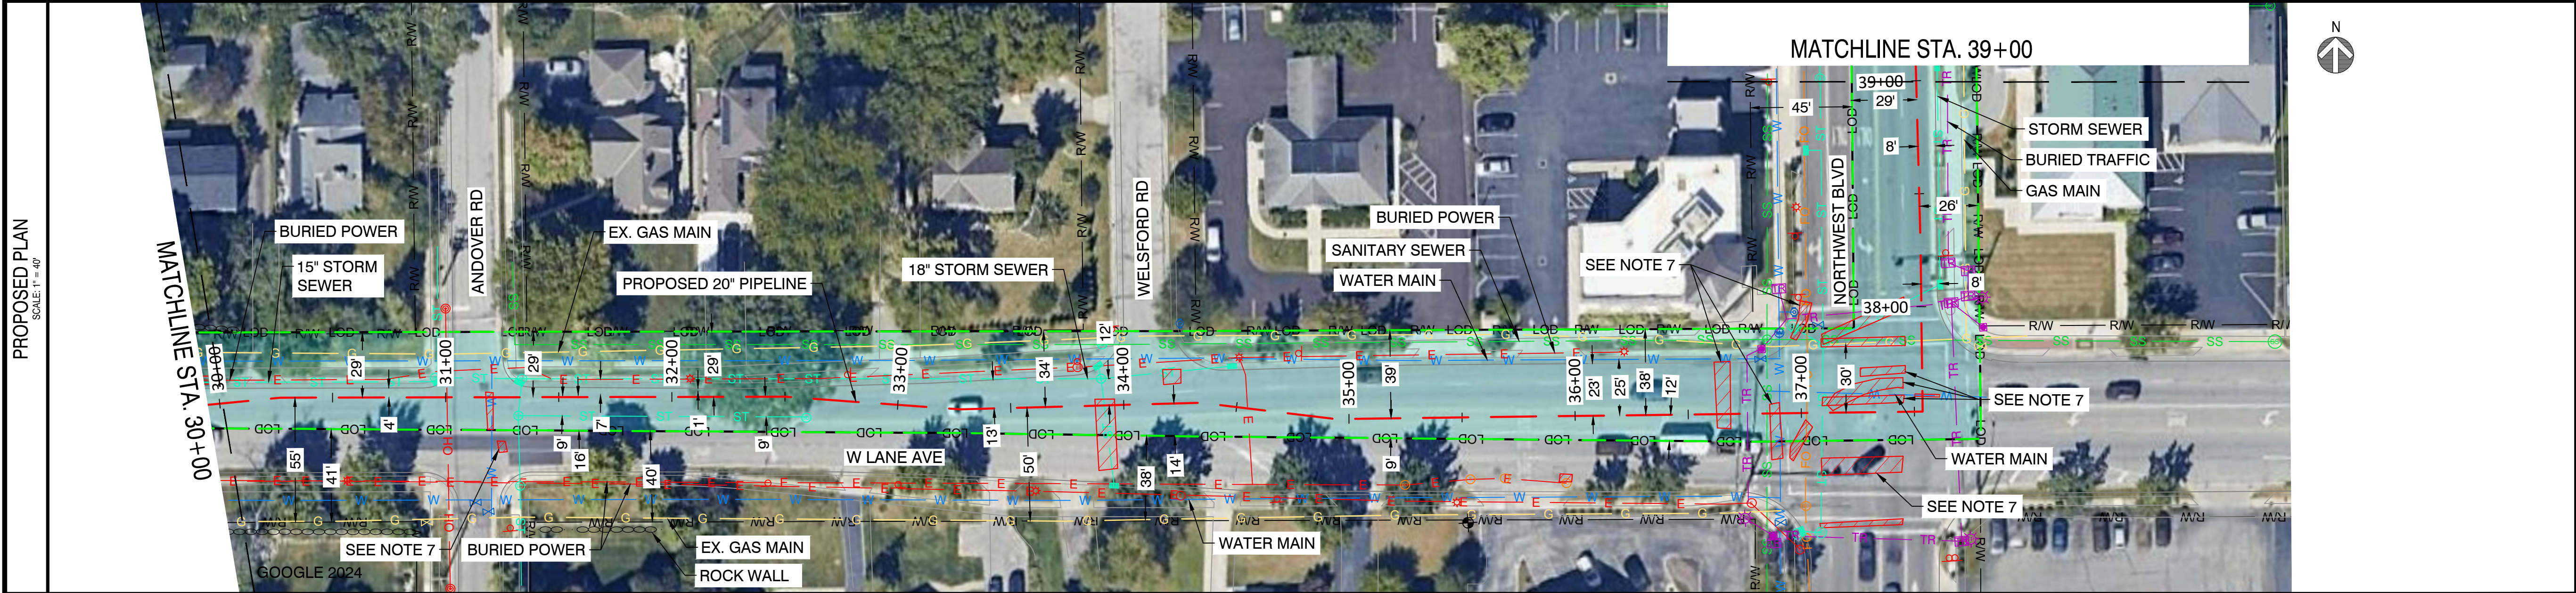

- NOTES:
- CONTRACTOR SHALL VERIFY ALL UTILITY CROSSINGS
 - SERVICE LINE CROSSINGS SHOWN IN SURVEY ARE NOT STATIONED OR SHOWN IN PROFILE FOR CLARITY
 - THE PIPELINE HAS GENERALLY BEEN DESIGNED WITH A COVER OF 6'-0" TO ACCOUNT FOR THE DEPTH OF UNKNOWN SERVICE LINES. MINIMUM ALLOWABLE DEPTH OF COVER IS 4'-0"
 - VERTICAL BENDS CALLED OUT IN PROFILE ARE FOR REFERENCE. CONTRACTOR TO MAKE USE OF ROPING AND FIELD BENDS WHERE POSSIBLE

- CORROSION PROTECTION IS DESIGNED BY NISOURCE AND IS NOT COVERED WITHIN THE ENGINEER'S STAMP
- AERIAL IMAGERY IS FOR REFERENCE ONLY
- GPR FOUND EVIDENCE OF A TRENCH. SURVEY IS UNABLE TO CONFIRM WHETHER A UTILITY EXISTS WITHIN THIS TRENCH.



CAMPOS
EPC

401 N Front St, Suite 380, Columbus, OH 43215
(303) 623-3345

DRAFT

REVISIONS			
A	07/10/25	ISSUED FOR PERMIT	
REV. #	DATE	DESCRIPTION	
DESIGNED BY	EK	05/31/23	614-981-0661
DRAWN BY	JEM	05/31/23	855-266-7671
CHECKED BY	JMJ	05/31/23	855-226-7671
AS-BUILT BY	TBD	TBD	TBD
	NAME	DATE	PHONE #

SITE NAME:

INST# 24-0137354-00
ABAN# 24-0137355-00
INST# 24-0136890-00
ABAN# 24-0136891-00
PROJECT ID# 21-78791

NCHP PIPELINE REPLACEMENT, WEST CENTRAL
UPPER ARLINGTON, FRANKLIN COUNTY, OH

DRAWING TITLE:



20' TREMONT TO BRANDON ALIGNMENT
STA. 30+00 TO STA. 39+00

DRAWING NO:

L-2004

OWNERSHIP	CITY OF UPPER ARLINGTON	
JURISDICTION / PARCEL ID	CITY OF UPPER ARLINGTON / FRANKLIN COUNTY	
TEST PRESSURE / DESIGN INFO	1080 PSIG MIN / 1280 PSIG MAX / CLASS IV / 720 PSIG	
CONSTRUCTION METHOD	OPEN CUT	
	STA. 39+00	STA. 48+00

HORIZONTAL STATIONING	STA. 39+28 DOT FIBER OPTIC LINE STA. 39+32 DOP OVERHEAD POWER STA. 39+33 10" SANITARY SEWER STA. 40+33 12" STORM SEWER STA. 43+37 12" STORM SEWER STA. 45+85 12" STORM SEWER
-----------------------	---

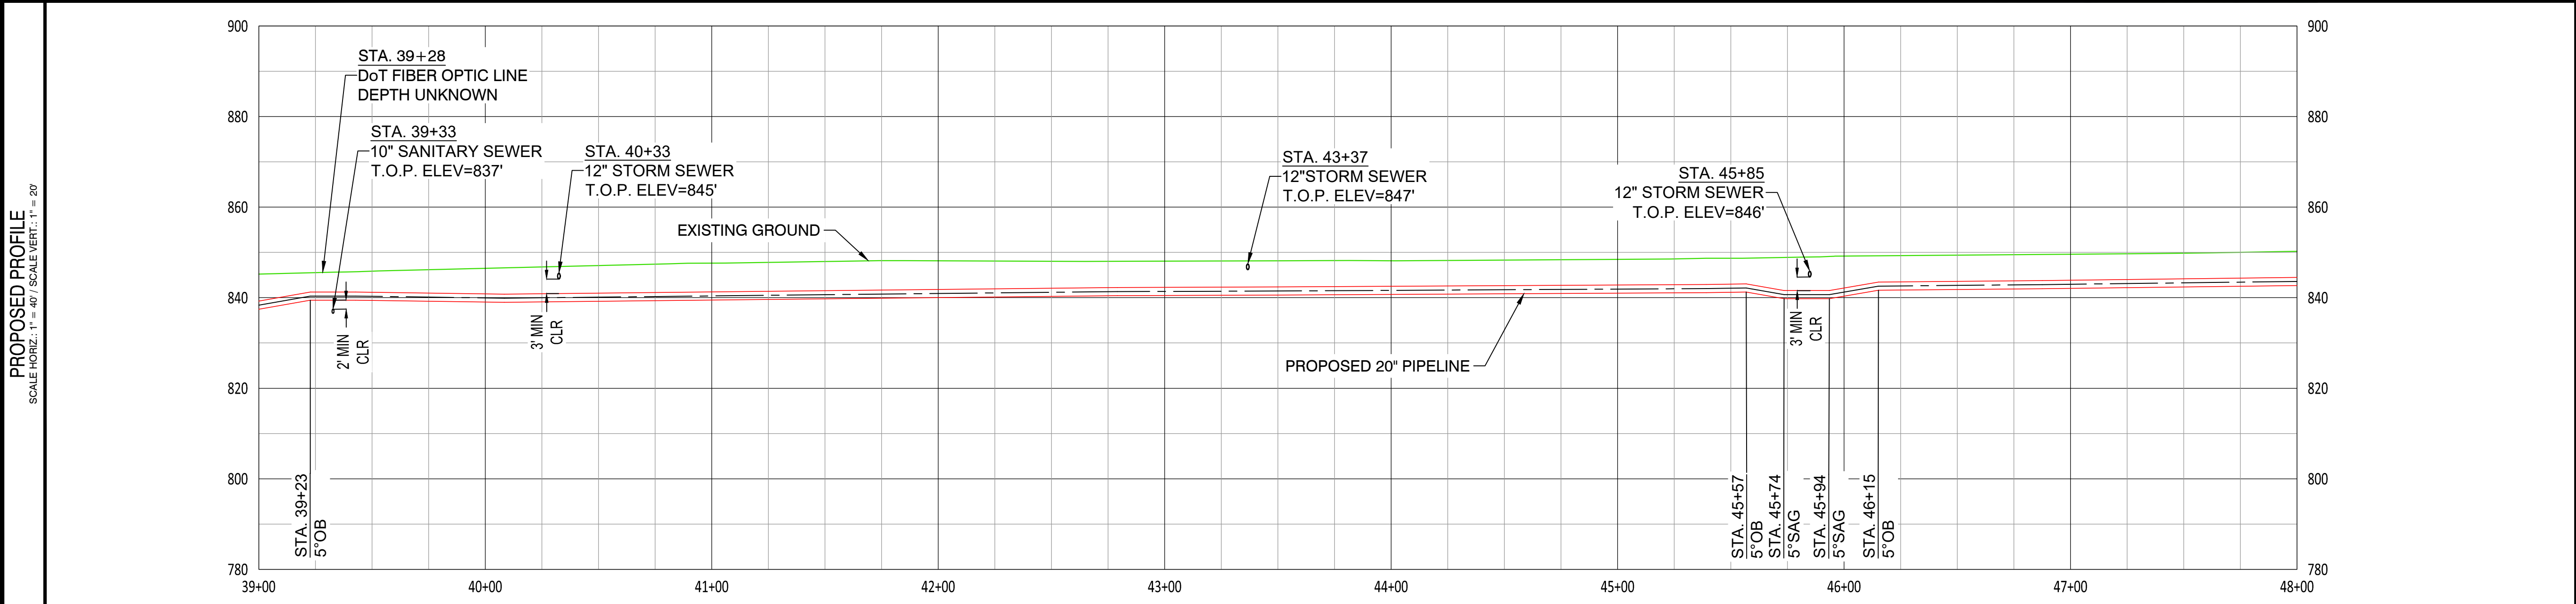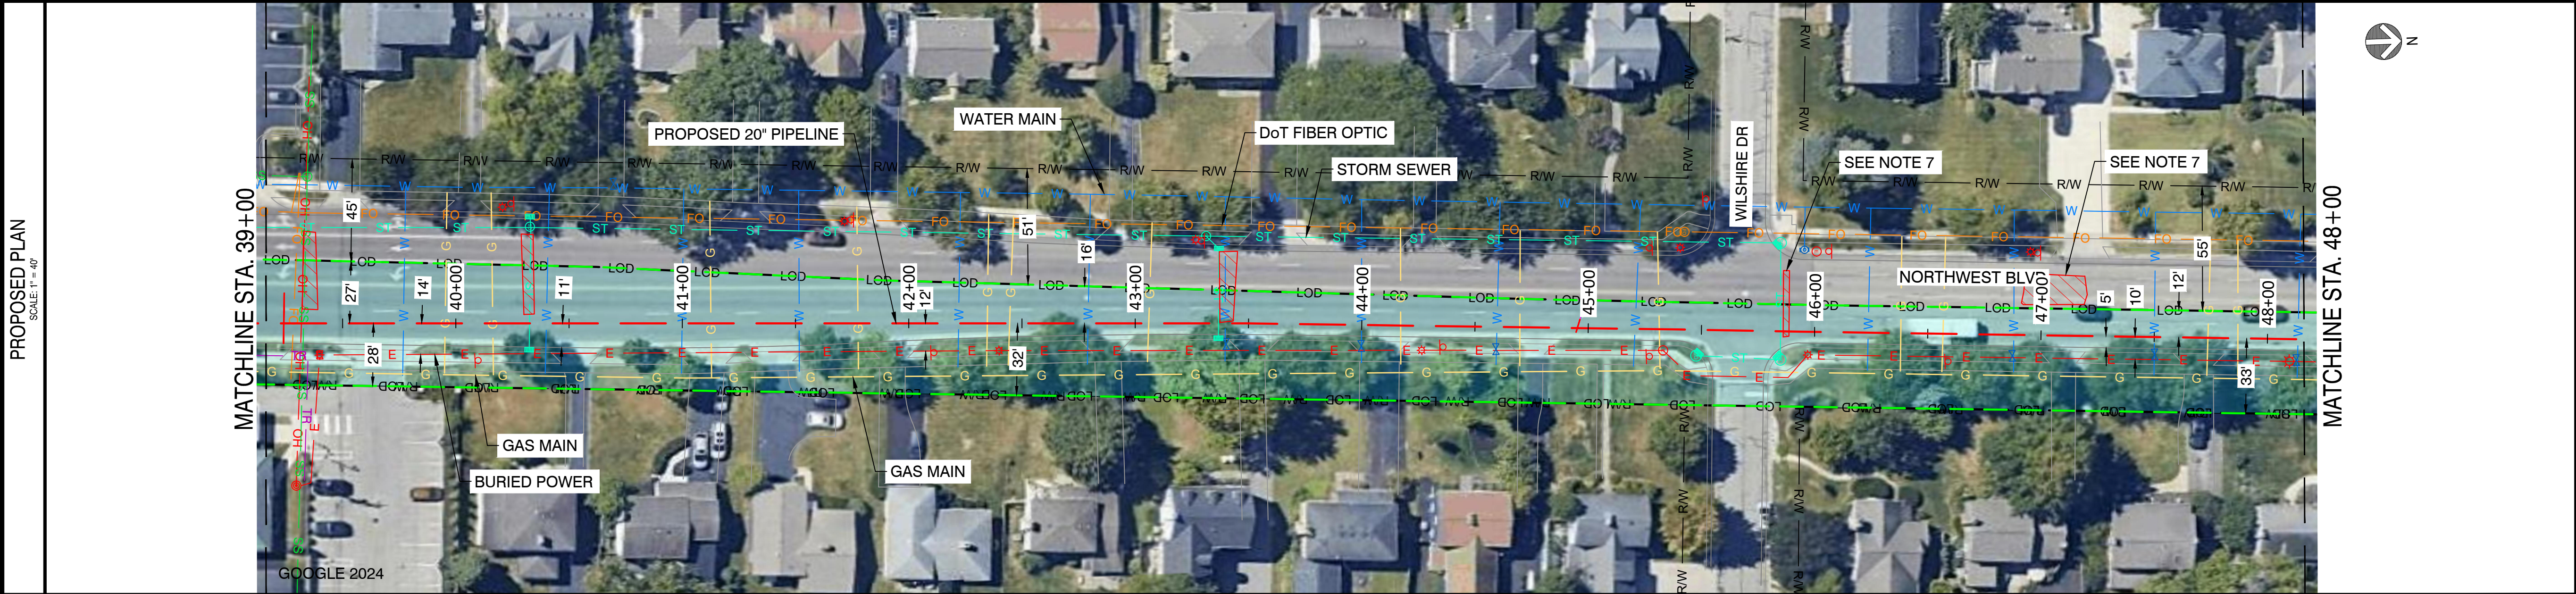

- NOTES:
1. CONTRACTOR SHALL VERIFY ALL UTILITY CROSSINGS

2. SERVICE LINE CROSSINGS SHOWN IN SURVEY ARE NOT STATIONED OR SHOWN IN PROFILE FOR CLARITY

3. THE PIPELINE HAS GENERALLY BEEN DESIGNED WITH A COVER OF 6'-0" TO ACCOUNT FOR THE DEPTH OF UNKNOWN SERVICE LINES. MINIMUM ALLOWABLE DEPTH OF COVER IS 4'-0"

4. VERTICAL BENDS CALLED OUT IN PROFILE ARE FOR REFERENCE. CONTRACTOR TO MAKE USE OF ROPING AND FIELD BENDS WHERE POSSIBLE
5. CORROSION PROTECTION IS DESIGNED BY NISOURCE AND IS NOT COVERED WITHIN THE ENGINEER'S STAMP

6. AERIAL IMAGERY IS FOR REFERENCE ONLY

7. GPR FOUND EVIDENCE OF A TRENCH. SURVEY IS UNABLE TO CONFIRM WHETHER A UTILITY EXISTS WITHIN THIS TRENCH.

Ohio Utilities Protection Service

401 N Front St, Suite 380, Columbus, OH 43215
(303) 623-3345

DRAFT

REVISIONS			
REV. #	DATE	ISSUED FOR PERMIT	DESCRIPTION
A	07/10/25	ISSUED FOR PERMIT	

DESIGNED BY	EK	05/31/23	614-981-0661
DRAWN BY	JEM	05/31/23	855-266-7671
CHECKED BY	JMJ	05/31/23	855-226-7671
AS-BUILT BY	TBD	TBD	TBD
	NAME	DATE	PHONE #

SITE NAME:

INST# 24-0137354-00
ABAN# 24-0137355-00
INST# 24-0136890-00
ABAN# 24-0136891-00
PROJECT ID# 21-78791
NCHP PIPELINE REPLACEMENT, WEST CENTRAL
UPPER ARLINGTON, FRANKLIN COUNTY, OH

DRAWING TITLE:

20' TREMONT TO BRANDON ALIGNMENT
STA. 39+00 TO STA. 48+00

DRAWING NO:

L-2005



OWNERSHIP	STA. 48+00	CITY OF UPPER ARLINGTON	STA. 55+00
JURISDICTION / PARCEL ID		CITY OF UPPER ARLINGTON / FRANKLIN COUNTY	
TEST PRESSURE / DESIGN INFO		1080 PSIG MIN / 1280 PSIG MAX / CLASS IV / 720 PSIG	
CONSTRUCTION METHOD		OPEN CUT	
PIPE (HORIZONTAL LENGTH)			
FITTINGS (ACTUAL LENGTH)			



Ohio Utilities Protection Service
Call 811
before you dig

 **CAMPOS**
EPC
401 N Front St, Suite 380, Columbus, OH 43215
(303) 623-3345

DRAFT

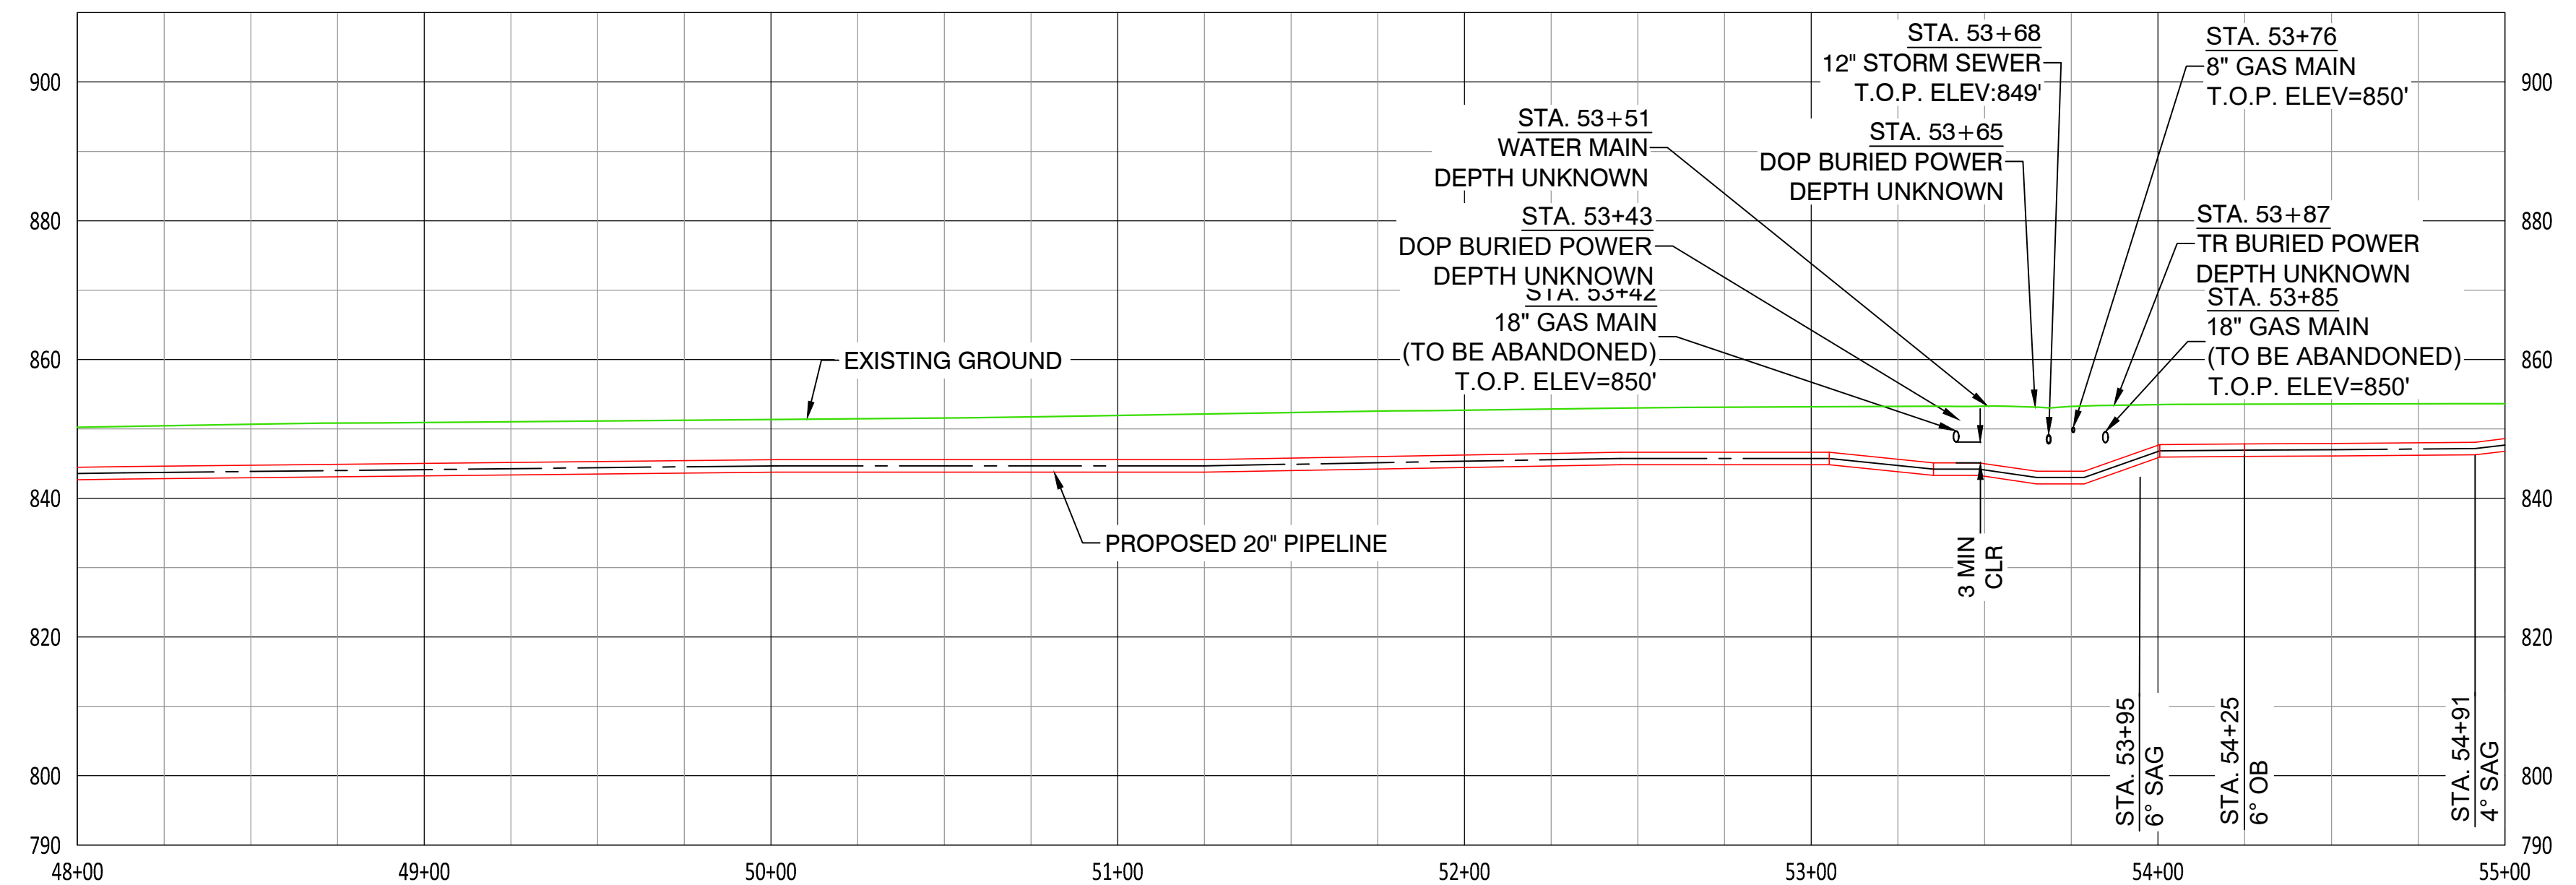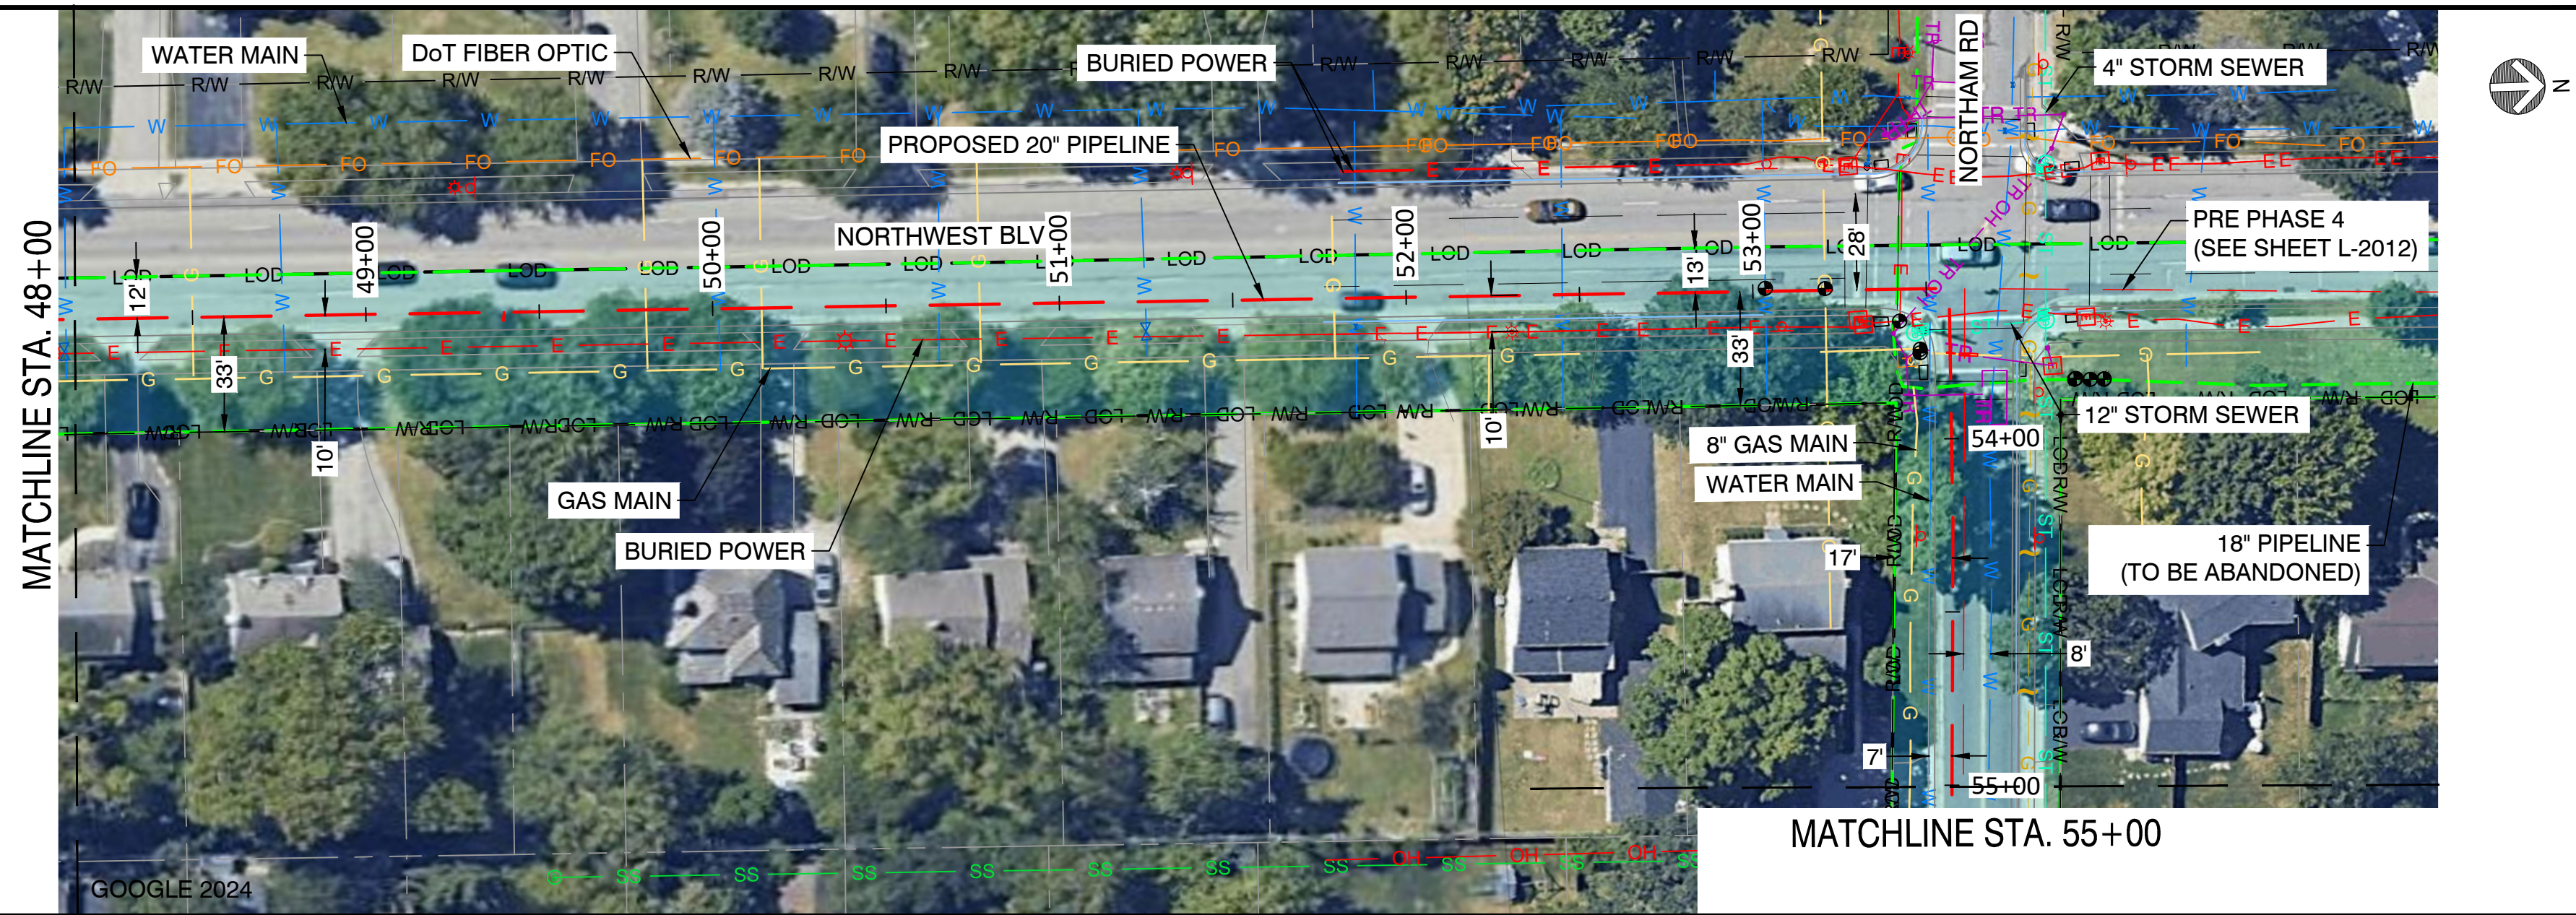

- | | | | |
|--------|---|----|---|
| NOTES: | | 4. | VERTICAL BENDS CALLED OUT IN PROFILE ARE FOR REFERENCE. CONTRACTOR TO MAKE USE OF ROPING AND FIELD BENDS WHERE POSSIBLE |
| 1. | CONTRACTOR SHALL VERIFY ALL UTILITY CROSSINGS | 5. | CORROSION PROTECTION IS DESIGNED BY NISOURCE AND IS NOT COVERED WITHIN THE ENGINEER'S STAMP |
| 2. | SERVICE LINE CROSSINGS SHOWN IN SURVEY ARE NOT STATIONED OR SHOWN IN PROFILE FOR CLARITY | 6. | AERIAL IMAGERY IS FOR REFERENCE ONLY |
| 3. | THE PIPELINE HAS GENERALLY BEEN DESIGNED WITH A COVER OF 6'-0" TO ACCOUNT FOR THE DEPTH OF UNKNOWN SERVICE LINES. MINIMUM ALLOWABLE DEPTH OF COVER IS 4'-0" | | |

REVISIONS			
A	07/10/25	ISSUED FOR PERMIT	
REV. #	DATE	DESCRIPTION	
DESIGNED BY	EK	05/31/23	614-981-0661
DRAWN BY	JEM	05/31/23	855-266-7671
CHECKED BY	JMJ	05/31/23	855-226-7671
AS-BUILT BY	TBD	TBD	TBD
	NAME	DATE	PHONE #

SITE NAME:

INST# 24-0137354-00
ABAN# 24-0137355-00
INST# 24-0136890-00
ABAN# 24-0136891-00
PROJECT ID# 21-78791

NCHP PIPELINE REPLACEMENT, WEST CENTRAL
UPPER ARLINGTON, FRANKLIN COUNTY, OH

DRAWING TITLE:
20" TREMONT TO BRANDON ALIGNMENT
STA. 48+00 TO STA. 55+00

DRAWING NO:
L-2006